



Sweetwater Utilities Board and/or Developer must install lateral and a clean out at property line or locate lateral prior to customer digging line to house in order to determine proper slope.

Customer's pipe shall be watertight sealed joints, and so constructed that no surface or rainwater can enter into the sewer system.


Customer's pipe shall not be less than four (4) inches (nominal diameter) and must be laid on firm ground, with no voids under pipe. Pipe shall be laid straight and to a uniform slope toward the street. Minimum slope of 1/8" per foot.

Flexible couplings or transition fittings shall be used to join plain ends of similar or dissimilar pipes. Flexible couplings shall consist of an approved gasket that is attached to the pipe with special adjustable stainless-steel clamps and bolts.

Where different sizes of pipe or pipes and fittings are to be connected the proper size increasers or reducers shall be used between the two sizes. Fittings or connections that offer abnormal obstruction to flow shall not be used.

Cleanouts shall be installed at not more than 100 feet apart. Mandatory locations are within 2 feet of the foundation but in no case shall they be less than eighteen inches from the foundation and at each change of direction which is greater than forty-five degrees. Cleanouts shall be installed to permit cleaning in the direction of the flow. Cleanouts shall be of the same nominal size as the pipes they serve.

Sweetwater Utilities Board will perform inspection in customer's pipe in the yard before it is covered up and, if satisfactory, will be put in service.

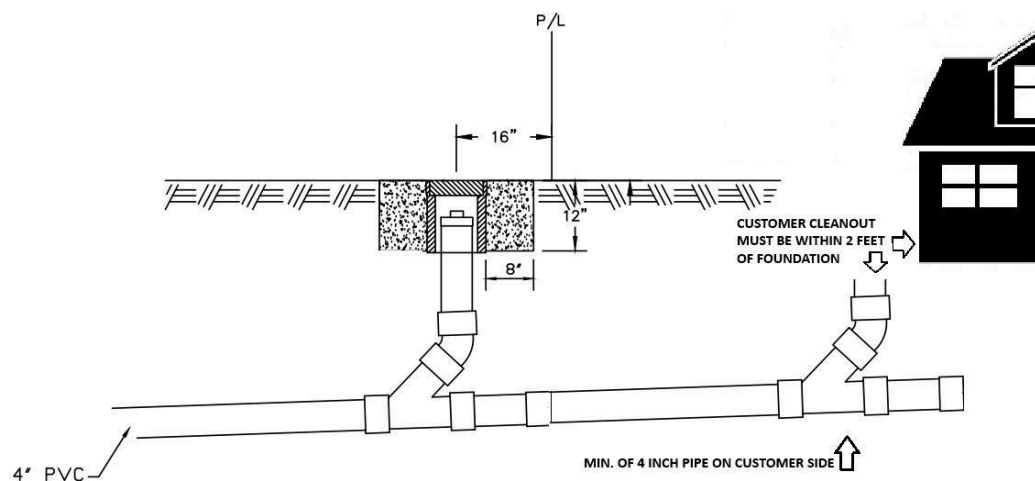

CLEAN-OUT DETAIL

